

CASE STUDY

Tandem Foods, Commack, NY Installed by Absolute Air & Power

Scope of the Job:

Replacement of the existing aging cast iron boiler system with the installation of eight high-efficiency Navien NCB/399 boilers to improve system reliability, energy efficiency, and long-term operational performance.

Four boilers installed opposite four additional boilers to create a balanced and space-efficient mechanical room layout. Each bank of four boilers was manifolded together using 6" Centrotherm InnoFlue®, allowing for a streamlined common venting arrangement and simplified maintenance access.

The venting system was routed horizontally through the building sidewall before transitioning vertically up the exterior wall to terminate above the roofline in accordance with manufacturer's specifications and code requirements.

Product Used:


6" InnoFlue® Polypropylene Common Vent System for exhaust venting.

Installer Info:

Absolute Air & Power

Phone: 516.809.7991

Location: 190 Jerusalem Ave Massapequa, NY 11758

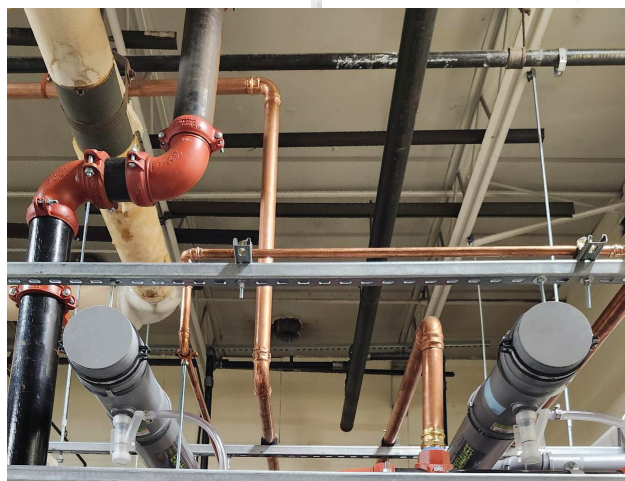

**ABSOLUTE
AIR & POWER**

CENTRAL AIR. HEATING. DUCTLESS.

Contact Us:

<http://centrotherm.us.com>
info@centrotherm.us.com
518.434.3400



UL 1738
ULC S636

TESTIMONIAL

CSTF2026
Rev 01

Matt Gritman, Navien Sales Representative, NYC and Long Island, David Gooding, Inc.

“In New York City, compliance isn’t optional. With the **DOB strictly enforcing UL 1738 standards** and banning standard PVC and CPVC for flue gas venting, **Centrotherm has become the go-to solution across NYC, Long Island, and the lower New York market.**”

– Matt Gritman, “Navien Sales Representative”


Centrotherm is one of the most widely available venting systems through wholesalers in the New York area because it meets the strict UL 1738 requirements for Category IV gas appliances. Contractors and installers consistently choose it because it combines compliance, reliability, and ease of installation.

“Centrotherm is lightweight, easy to cut, easy to size, and simple to put together.”


Installers appreciate the efficiency it brings to the job site. The system is designed for quick assembly while maintaining the temperature ratings and certified performance manufacturers require under UL 1738 exhaust piping regulations.

“It has the correct temperature rating every manufacturer is looking for under UL 1738 code requirements.”

Its widespread availability, contractor-friendly installation, and trusted compliance make Centrotherm a preferred venting solution throughout New York City and Long Island.

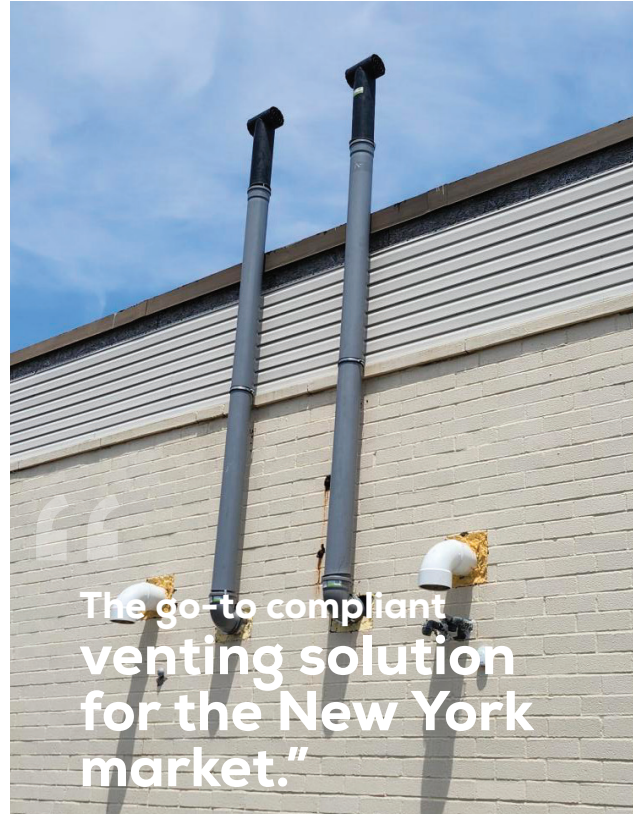

The go-to compliant venting solution for the New York market.”

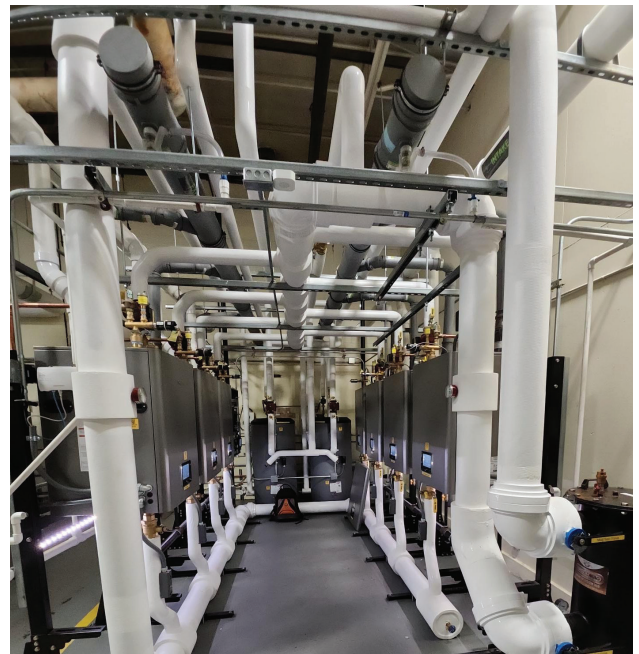

Centrotherm

Contact Us:

<http://centrotherm.us.com>
info@centrotherm.us.com
518.434.3400



Centrotherm

InnoFlue®
Polypropylene Vent Systems



**UL 1738
ULC S636**